



Seal Gard 32 and 54 Standardized External Seal Flush Water Controllers



Experience In Motion

The Seal Gard water flush controller protects your seal by improving the seal environment with external flush water and increases the mean time between planned maintenance (MTBPM).



Conserve water, save seals

The Seal Gard provides a unitized, cost-effective means of delivering cool, clean flush water to packing and single or dual mechanical seals. Key benefits include:

- Regulating flush water flow rates saves water and energy and reduces expenses.
- Assuring adequate flow for seal cooling extends seal life and equipment uptime.
- Eliminating excessive flush rates removes a common cause of seal face erosion.

The Seal Gard's standard instrumentation includes flow and pressure gauges to visually check the seal's operating environment. An optional alarm is available to alert operators of a loss of flush water or excessive flush water consumption, allowing immediate action to be taken for preventative health of the seal.

Standardized feature packages simplify Seal Gard selection process and reduce delivery time.

Two main body types satisfy the essential requirements of single and dual seal piping plans with features designed to provide the right amount of visualization and control.

The Seal Gard is stocked in common configurations to decrease the time from order to installation.

Seal Gard 32

Single seals appreciate the cooling and assured lubrication provided by a Seal Gard 32, which follows API 682 guidelines for a Plan 32. The Seal Gard 32 flushes externally supplied clean water through the seal to remove heat, process fluids and solids from the seal chamber, and increase the seal chamber pressure and fluid vapor margin.

Seal Gard 54

The Seal Gard 54 is specially designed for use on dual seals operating with a Plan 54 and an external water supply. The Seal Gard 54 allows operators to monitor the dual seals' barrier chamber, adjust flow, and set the barrier fluid operating pressure.

The Seal Gard 54 is available with a single or dual flow meter to enable multiple flow alarm setpoints and monitor flush rates to and from the seal's barrier cavity.

Detect upset conditions

Available proximity flow sensor can be added to any Seal Gard and configured to alarm on a high-flow or low-flow reading.

Desired setpoint indicating arrows on flow meter and pressure gauge let operators know with a glance whether the seal is operating in the right flush water conditions.

Flow meter

Freeze-resistant dual unit, hang-up resistant, with repeatable measurements to ±1%. Dual flow meter Seal Gard 54 available to show flow to and from seal (page 5).

Optional adjustable constant flow regulator

Reduces false flow alarm triggers by stabilizing flow to the seal, despite changes in supply or seal chamber pressure.

Plunger wiper rod

Double wiper plunger with removable rod can clean flow meter sight glass while equipment is running. As shown, rod is safely stored on base bracket.

Dual unit, stainless steel pressure gauge


Flow and back pressure control valves

Clog-resistant with tamper-resistant locknuts. Passes solids five times larger than a standard needle valve.

Check valve

Prevents process fluid from contaminating supply header.

Optional 316SS floor-mount stand

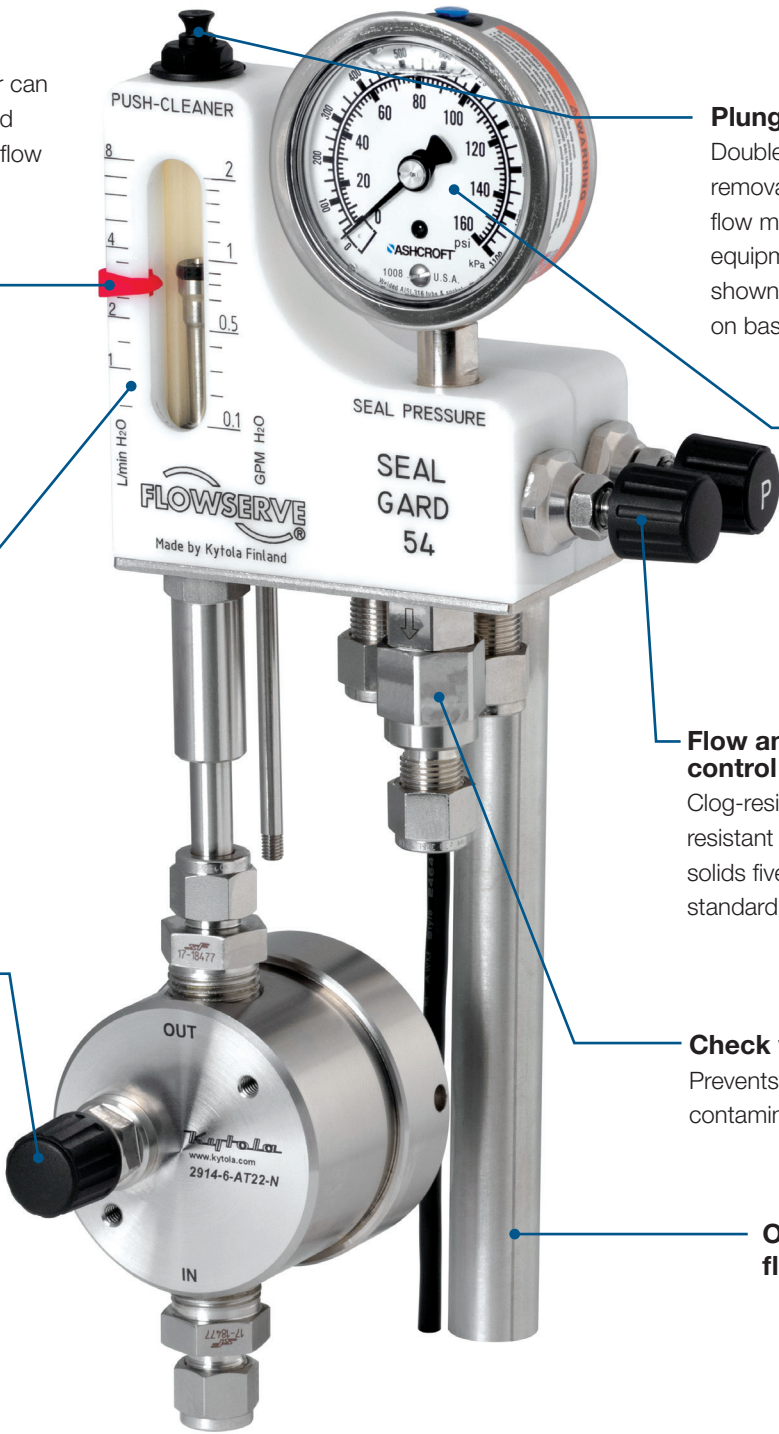

Materials of construction	
Body	Polyoxymethylene (POM)
Metering tube	Polysulfone plastic (PSU)
Metallic parts	316 stainless steel
Float	329 stainless steel
O-ring seals	Fluoroelastomer (FKM)
Connectors	3/8 in compression fitting

Operating parameters	
Design MAWP	25 bar @ 100°C (362 psi @ 212°F)
Flow	0.5 to 13 lpm (0.1 to 3.5 gpm)
Flow alarm range	1 to 9 lpm (0.25 to 2.5 gpm)
Flow measurement repeatability	±1%
External flush fluid	Water
Temperature range	-16°C to 100°C (4°F to 212°F)

Seal Gard 32

The Seal Gard 32's compact size enables users to install it conveniently near the seal on the optional 75 cm (30 in) tall floor stand. Complete the installation by connecting a water source to the Seal Gard 32's inlet port and the outlet port to the seal using 3/8 in tubing. The Seal Gard 32 can be configured with either a low- or high-flow sensor. The low-flow sensor alerts users that clean flush fluid is no longer flowing to the seal, which can create an undesirable operating environment for the seal. Alternatively, the user can choose to configure the flow sensor to alarm on a high-flow reading in order to send an alert when excessive flush water is being consumed.

Set flow indicating mark at desired height

Pressure gauge will read slightly above the seal chamber pressure.

Adjust flow control valve until the top of the flow meter float is aligned with the flow-indicating mark, then tighten lock nut.

Supply Seal Gard 32 from a clean water source with a pressure of 1 bar (14.5 psi) higher than the seal chamber pressure.


Seal Gard 54 dual flow meter

The Seal Gard 54 dual flow meter provides additional monitoring capability for dual seals. Dual flow meters enable the installation of two flow sensors so alarms can be set for both high and low flows. One flow meter and optional flow sensor are on the supply side of the Seal Gard 54 going to the seal, and the other flow meter and optional flow sensor are on the return side monitoring the flow coming out of the seal. This enables the detection of several off-design conditions, including:

- Reverse pressurization of the inner seal
 - Detected by low or no flow on the supply side flow meter and a drop in indicated barrier pressure
- Excessive inner seal barrier fluid consumption
 - Detected by an increase in barrier fluid flow and confirmed by flow continuing when the flow control valve is temporarily closed
- Excessive outer seal barrier fluid consumption
 - Detected by an increase in barrier fluid flow, a drop in barrier pressure, and visible leakage around the seal's drive collar
- Excessive barrier fluid flow
 - Detected by high flow on supply side flow meter
- Insufficient barrier fluid flow
 - Detected by low flow on return side flow meter

Start with the flow control valve open and adjust after the pressure control valve is set.


Pressure gauge will indicate slightly higher than the actual seal barrier chamber pressure.

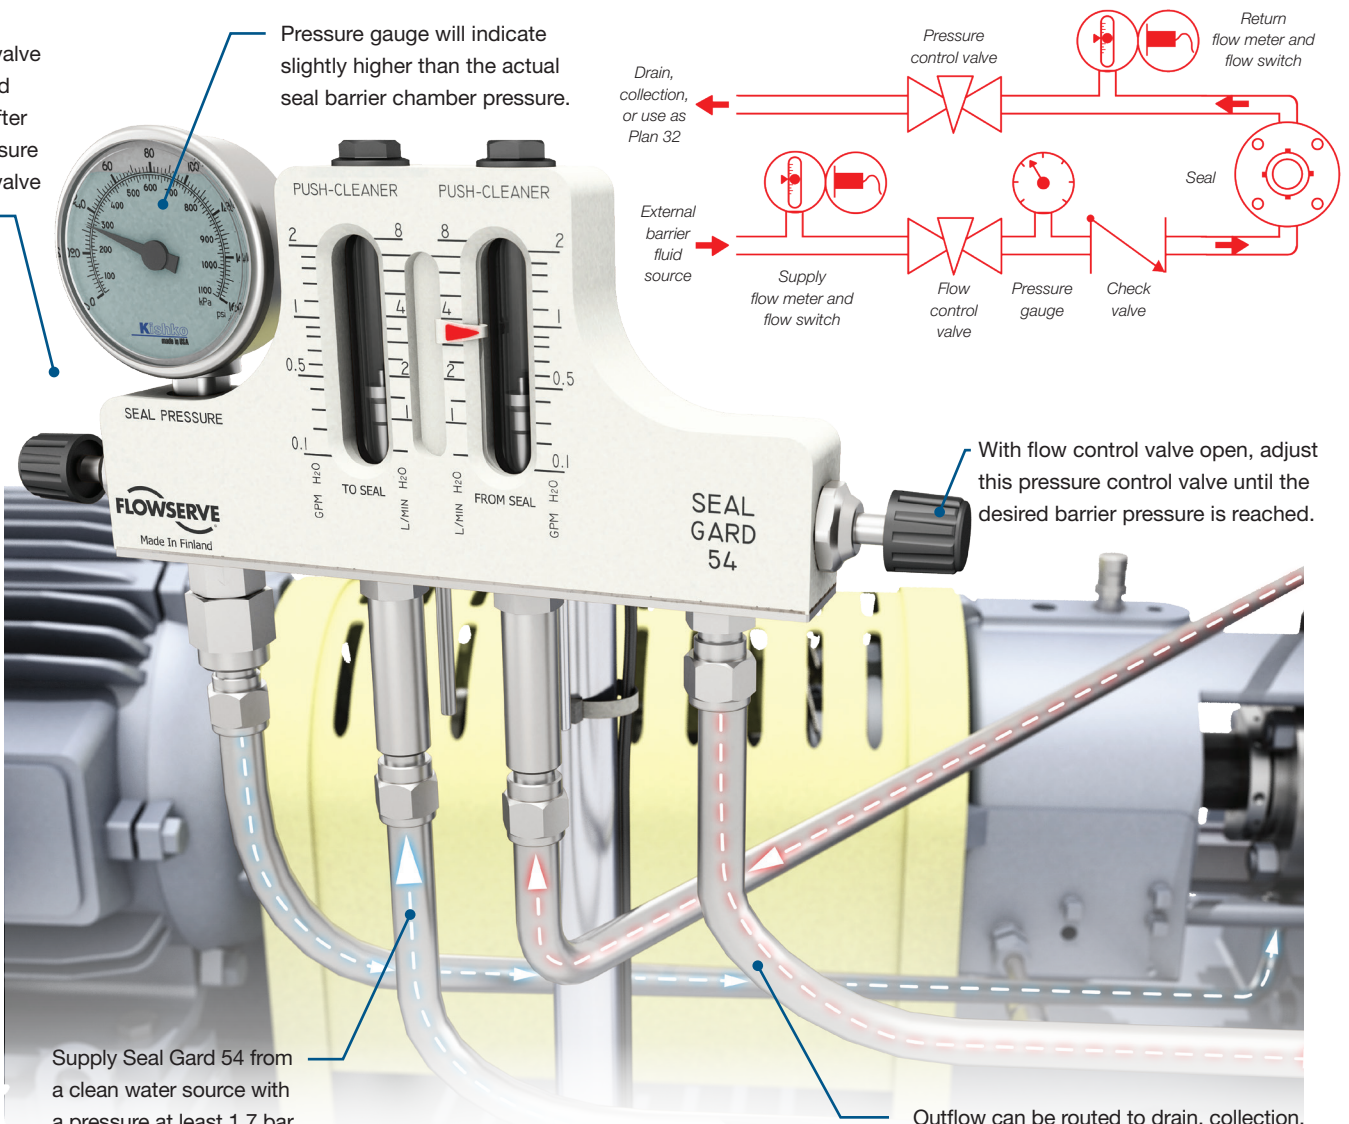

Supply Seal Gard 54 from a clean water source with a pressure at least 1.7 bar (25 psi) higher than the seal chamber pressure.

Outflow can be routed to drain, collection, or used as a Plan 32 flush.


Seal Gard 32 and 54 single flow meter dimensions and part numbers

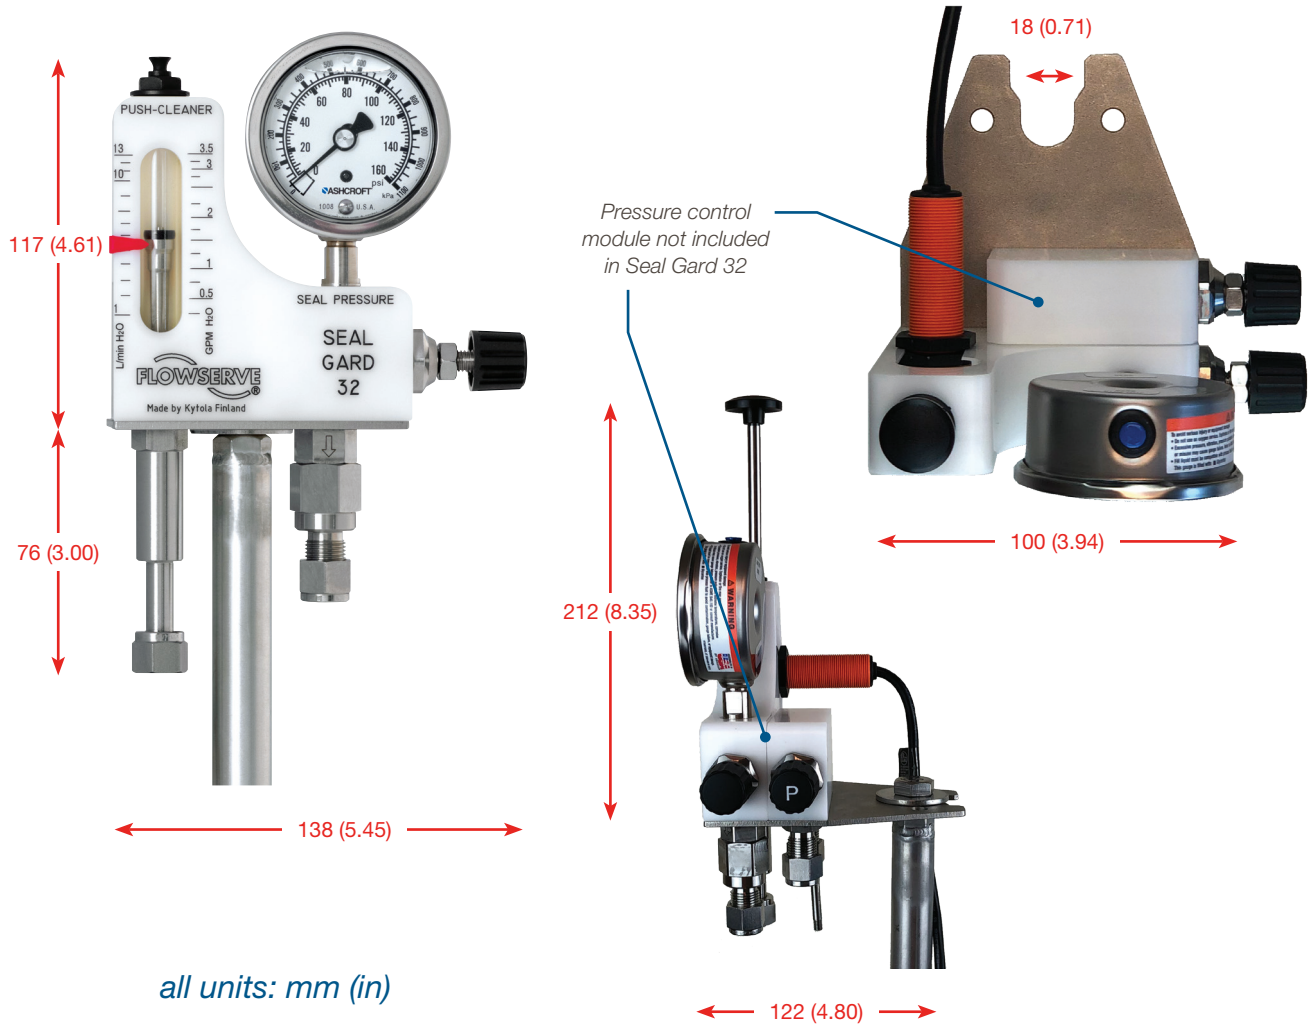

Seal Gard 32 Part Number	Flow Rate	Pressure Gauge
SGRD321L1PVT1	0.5 to 8 lpm (0.1 to 2 gpm)	1,100 kPa (160 psi)
SGRD321L2PVT1	0.5 to 8 lpm (0.1 to 2 gpm)	2,500 kPa (360 psi)
SGRD321H1PVT1	1 to 13 lpm (0.25 to 3.5 gpm)	1,100 kPa (160 psi)
SGRD321H2PVT1	1 to 13 lpm (0.25 to 3.5 gpm)	2,500 kPa (360 psi)

Seal Gard 54 Single Meter Part Number	Flow Rate	Pressure Gauge
SGRD541L1PVT1	0.5 to 8 lpm (0.1 to 2 gpm)	1,100 kPa (160 psi)
SGRD541L2PVT1	0.5 to 8 lpm (0.1 to 2 gpm)	2,500 kPa (360 psi)
SGRD541H1PVT1	1 to 13 lpm (0.25 to 3.5 gpm)	1,100 kPa (160 psi)
SGRD541H2PVT1	1 to 13 lpm (0.25 to 3.5 gpm)	2,500 kPa (360 psi)

Seal Gard 54 dual flow meter dimensions and part numbers

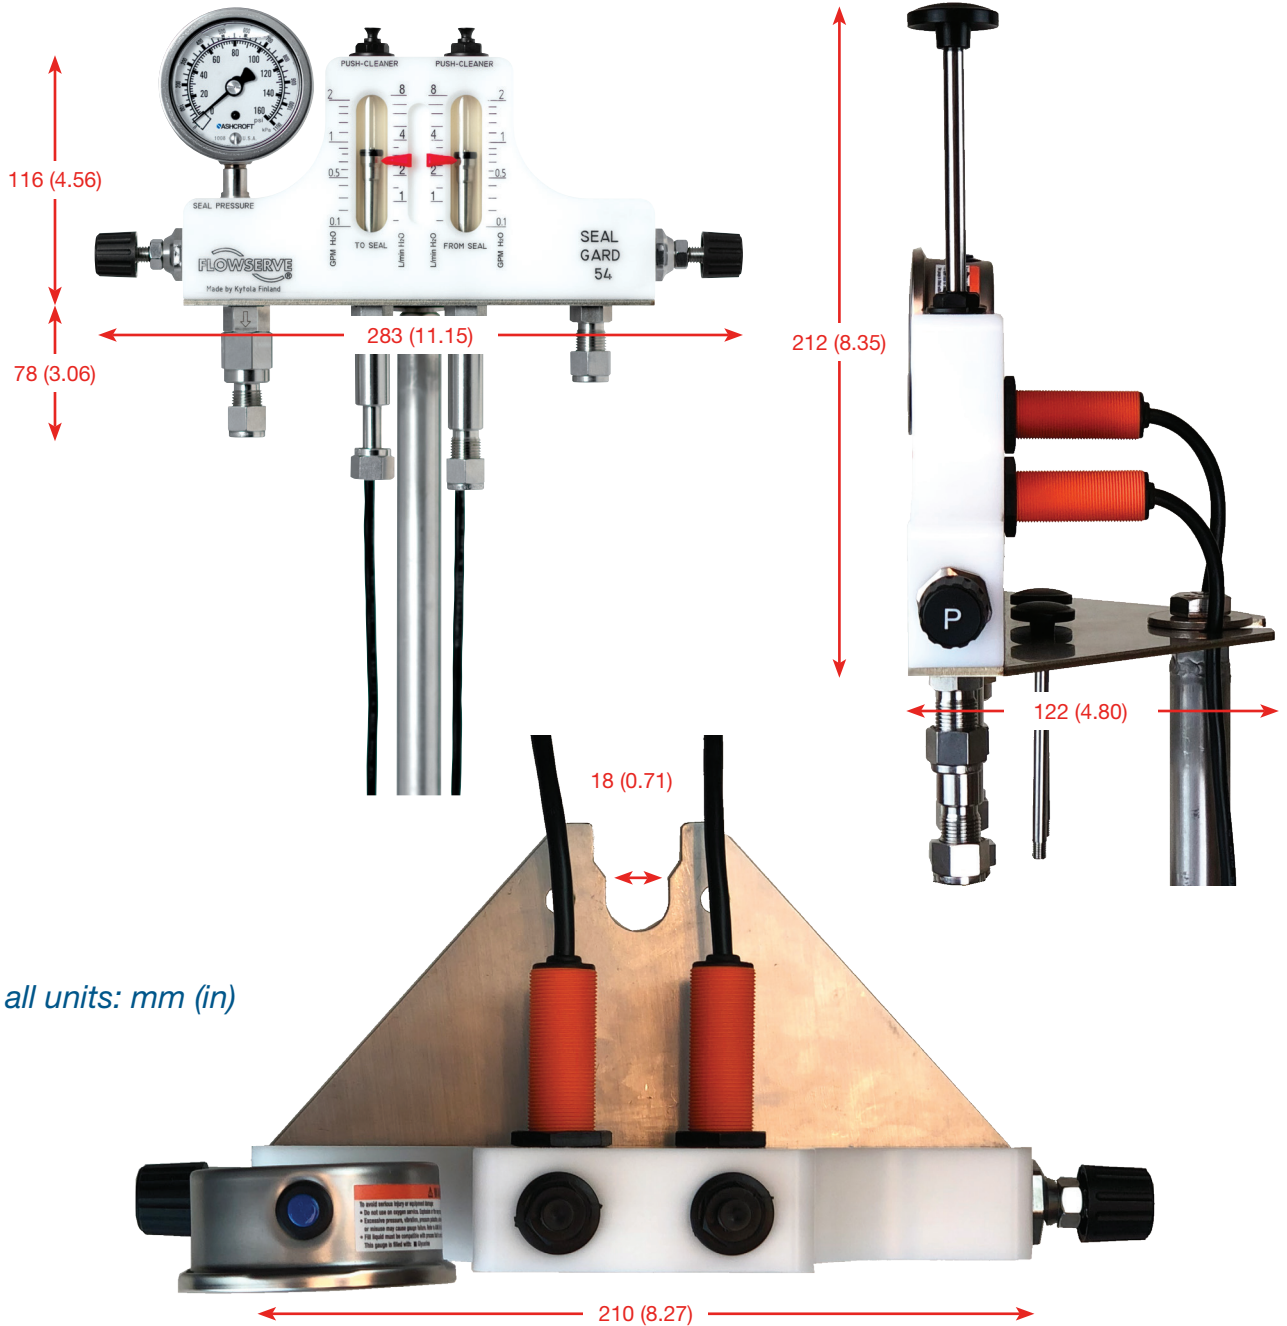

all units: mm (in)

Seal Gard 54 Dual Meter Part Number	Flow Rate	Pressure Gauge
SGRD542L1PVT1	0.5 to 8 lpm (0.1 to 2 gpm)	1,100 kPa (160 psi)
SGRD542L2PVT1	0.5 to 8 lpm (0.1 to 2 gpm)	2,500 kPa (360 psi)



Seal Gard 32 and 54 options

Seal Gard 32 and 54 Standard Options	Part Number
Flow alarm sensor, 10 to 55 VDC proximity switch	SGRD-ALARM10V
Flow alarm sensor, 20 to 250 VAC/DC proximity switch	SGRD-ALARM20V
316SS floor stand for Seal Gard 32 and 54	SGRD-STAND
Constant flow regulator up to 10 lpm (2.6 gpm)	SGRD-CONFLOW26
Constant flow regulator up to 13 lpm (3.5 gpm)	SGRD-CONFLOW35
Repair kit: Includes all O-rings, replacement flow meter tube and replacement cleaning rod	SGRD-REPAIRKIT
Flow alarm sensor kit, ATEX certified, intrinsically safe	SGRD-ALARMATEX
Hose barb adapter fitting (2) required SGRD 32, (4) required SGRD 54	SGRD-HOSEBARB

Seal Gard 32 and 54 Non-standard Options	
Connections	10 mm (3/8 in) hose barbs
Elastomers	EPDM
High chemical compatibility, higher-temperature body material	PVDF (polyvinylidene fluoride) thermoplastic

Flowserve Corporation
 5215 North O'Connor Blvd.
 Suite 700
 Irving, Texas 75039-5421 USA
 Telephone: +1 937 890 5839

Flowserve Corporation has established industry leadership in the design and manufacture of its products. When properly selected, this Flowserve product is designed to perform its intended function safely during its useful life. However, the purchaser or user of Flowserve products should be aware that Flowserve products might be used in numerous applications under a wide variety of industrial service conditions. Although Flowserve can provide general guidelines, it cannot provide specific data and warnings for all possible applications. The purchaser/user must therefore assume the ultimate responsibility for the proper sizing and selection, installation, operation, and maintenance of Flowserve products. The purchaser/user should read and understand the Installation Instructions included with the product, and train its employees and contractors in the safe use of Flowserve products in connection with the specific application.

While the information and specifications contained in this literature are believed to be accurate, they are supplied for informative purposes only and should not be considered certified or as a guarantee of satisfactory results by reliance thereon. Nothing contained herein is to be construed as a warranty or guarantee, express or implied, regarding any matter with respect to this product. Because Flowserve is continually improving and upgrading its product design, the specifications, dimensions and information contained herein are subject to change without notice. Should any question arise concerning these provisions, the purchaser/user should contact Flowserve Corporation at any one of its worldwide operations or offices.

©2021 Flowserve Corporation. All rights reserved. This document contains registered and unregistered trademarks of Flowserve Corporation. Other company, product, or service names may be trademarks or service marks of their respective companies.

SSBR000008-02 (EN/A4) November 2022